

Vertical Riser Support

Risers in fibrous glass duct systems of 8 feet (2.4m) or greater require the use of special support as shown in Fig. 6-7. This reinforcement and support are in addition to whatever reinforcement may be required by provisions of Section V of this Standard. Vertical riser supports shall be installed at maximum spacing intervals of 12 feet (3.6 m).

NOTE: Riser height is limited as stated in NFPA 90A "for vertical risers in air duct systems serving not more than two (2) stories."

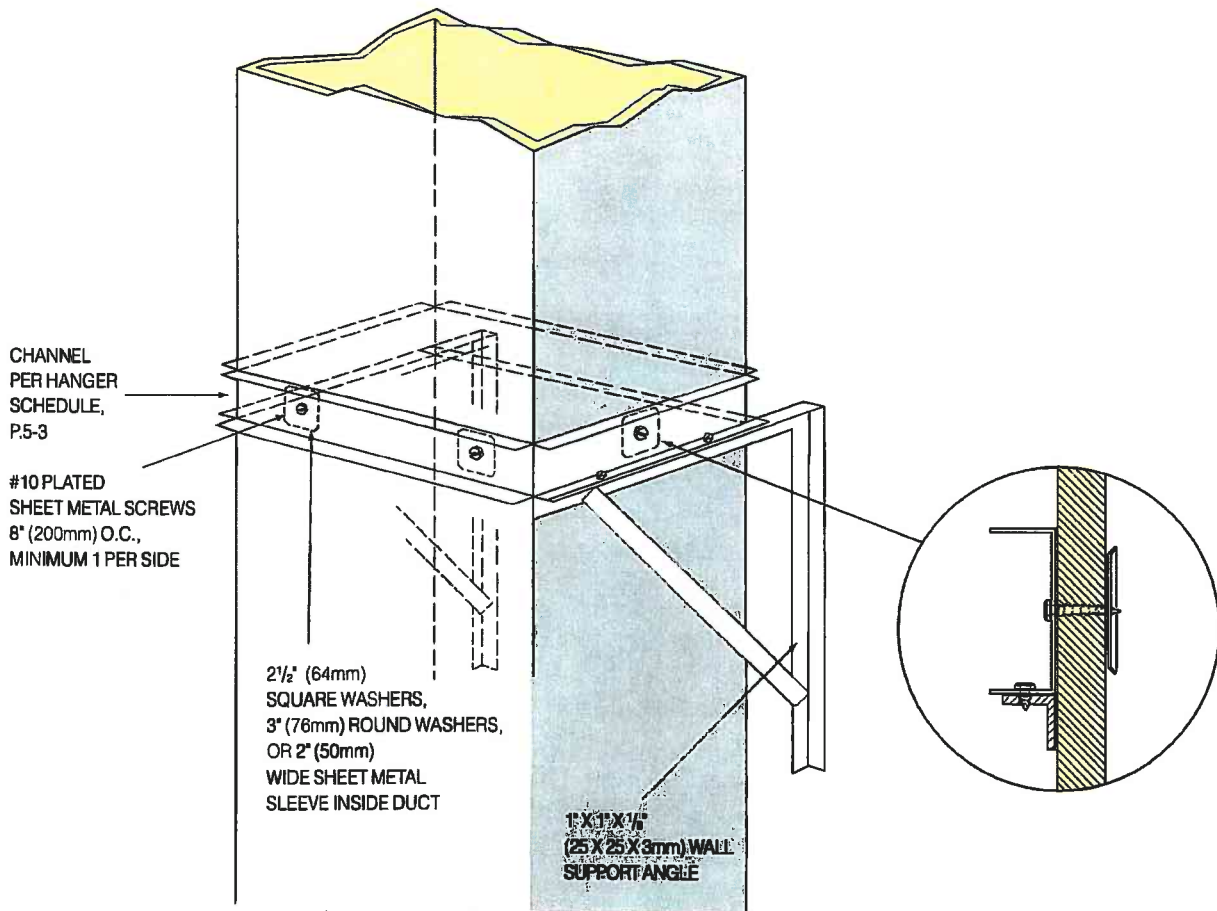


Fig. 6-7. Vertical riser support.